


Fire Hydrant, Typical

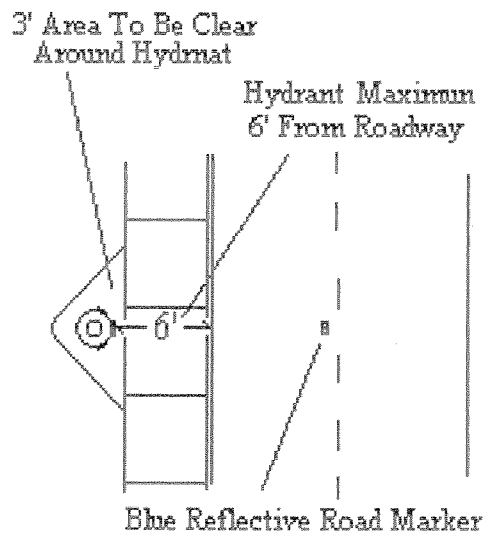


Fire Hydrant Placement & Location

Fire Hydrant, Placement, Location & Marking


Uniform Fire Code & Fire Safe Standards

**AUBURN FIRE
DEPARTMENT**


9/2003

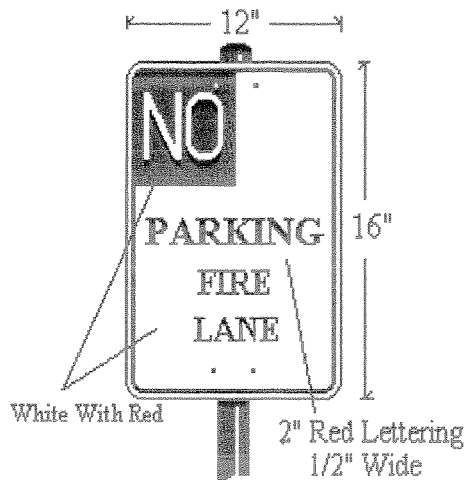

"No Parking Sign"

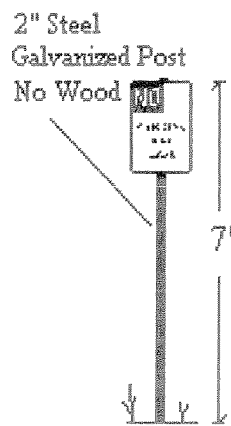

Posted Sign

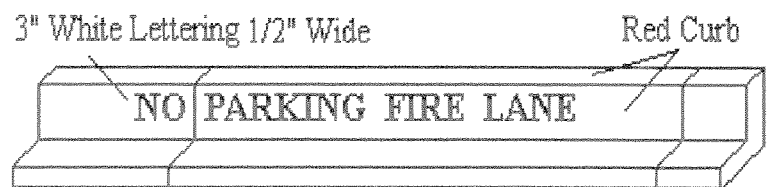


Red Curbing

"NO PARKING" Sign & Red Curbing


Uniform Fire Code & Fire Safe Standards

**AUBURN FIRE
DEPARTMENT**

9/2003

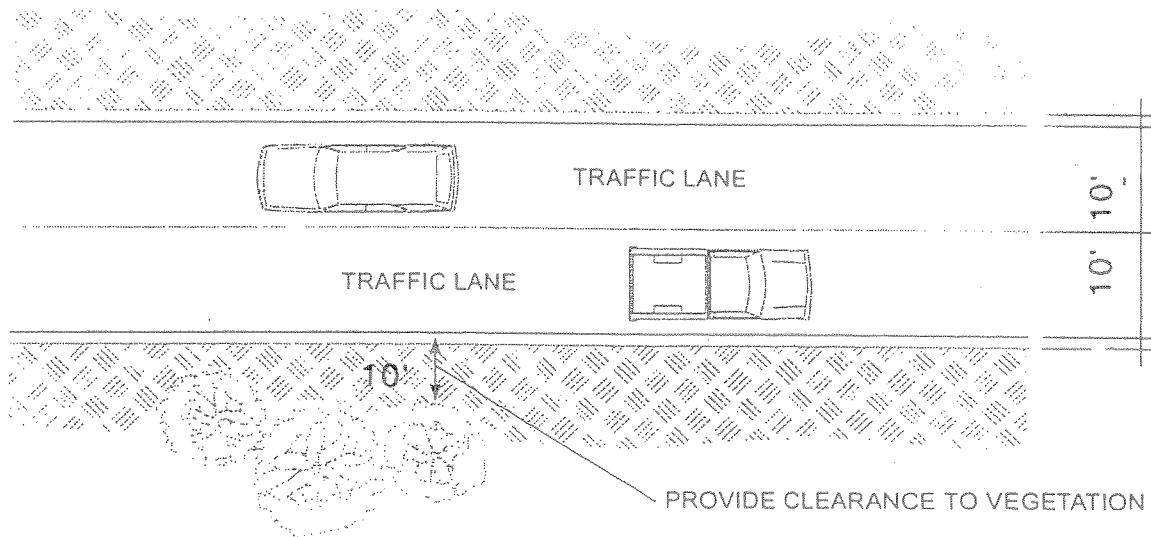

ROAD & PRIVATE LANES
 (With "No Parking")
 MINIMUM OF 2-10' LANES
 20' MINIMUM WIDTH

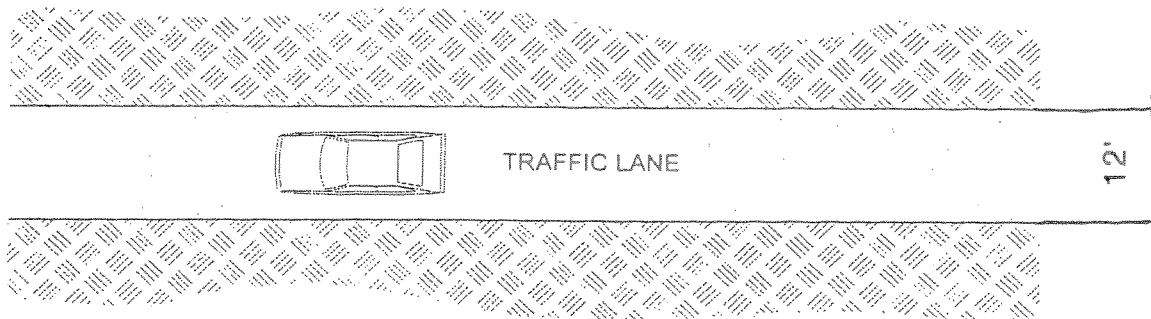


DRIVEWAY
 (With "No Parking")
 MINIMUM 12' TRAFFIC LANE

Road, Private Lane, Driveway

**AUBURN FIRE
DEPARTMENT**

Uniform Fire Code & Fire Safe Standards

9/2003

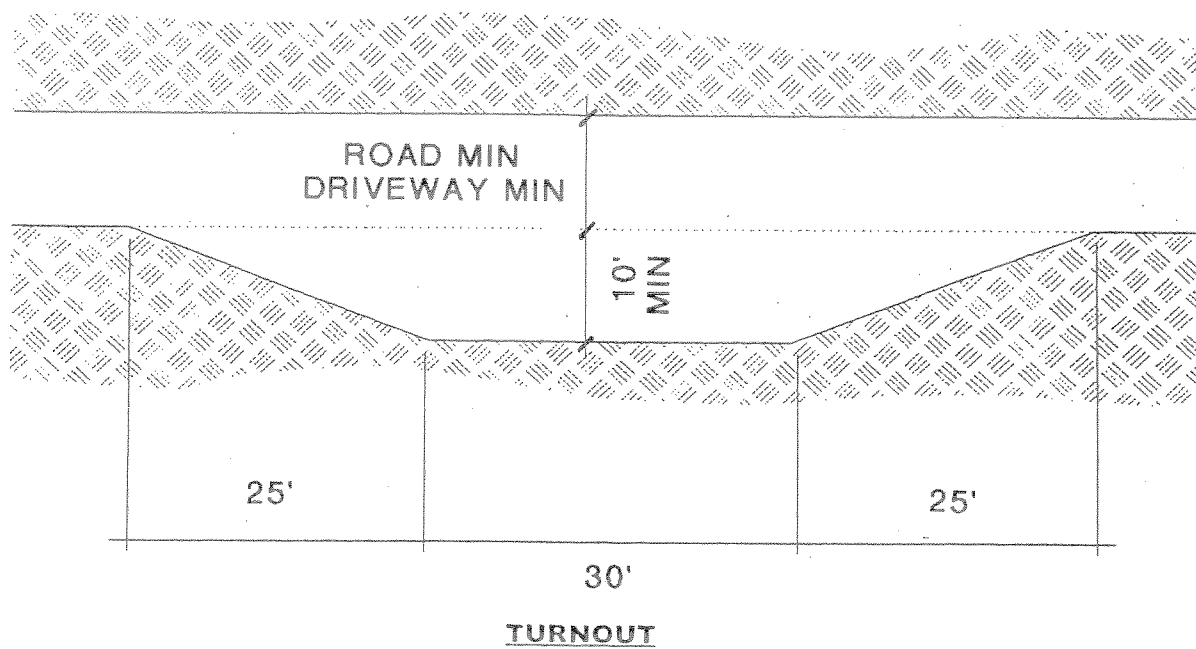


Turnout, One-Way Road & Driveway

**AUBURN FIRE
DEPARTMENT**

Uniform Fire Code & Fire Safe Standards

9/2003

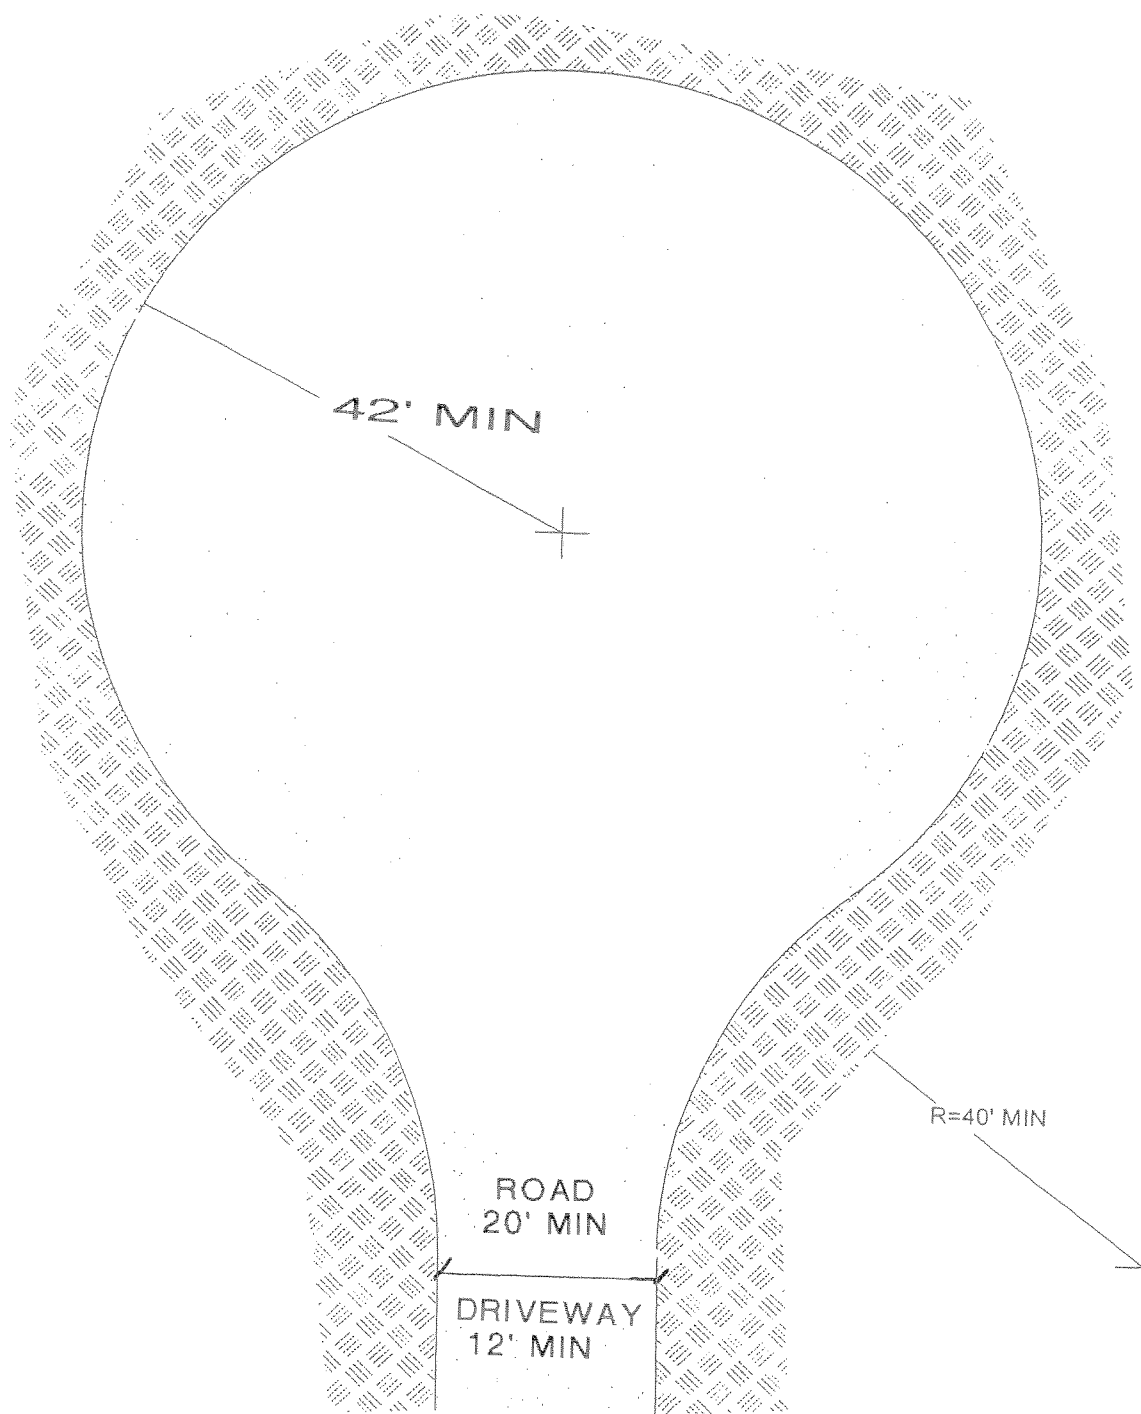


Turnaround, Cul-De-Sac
With "No Parking"

Turnaround, Road & Driveway

Uniform Fire Code & Fire Safe Standards

AUBURN FIRE
DEPARTMENT

9/2003

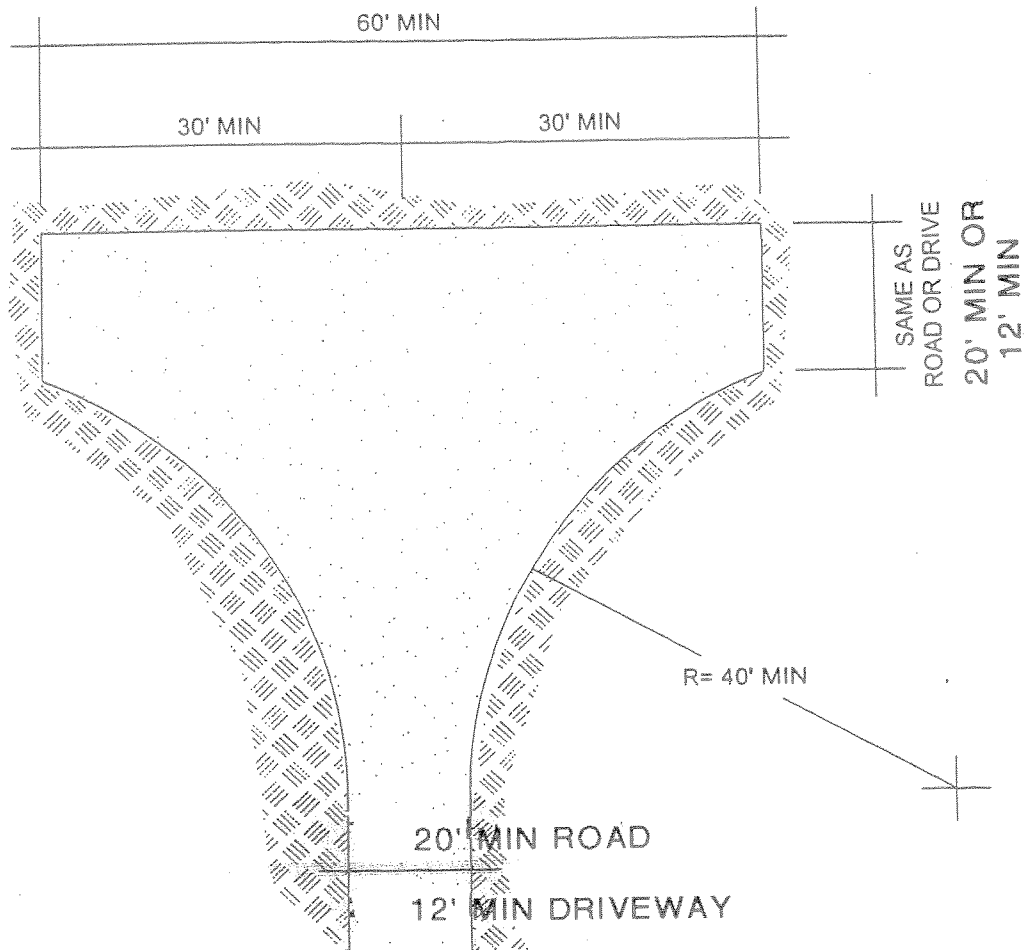


HAMMERHEAD TURNAROUND

Turnaround, Hammerhead, Road & Driveway

**AUBURN FIRE
DEPARTMENT**

Uniform Fire Code & Fire Safe Standards

9/2003

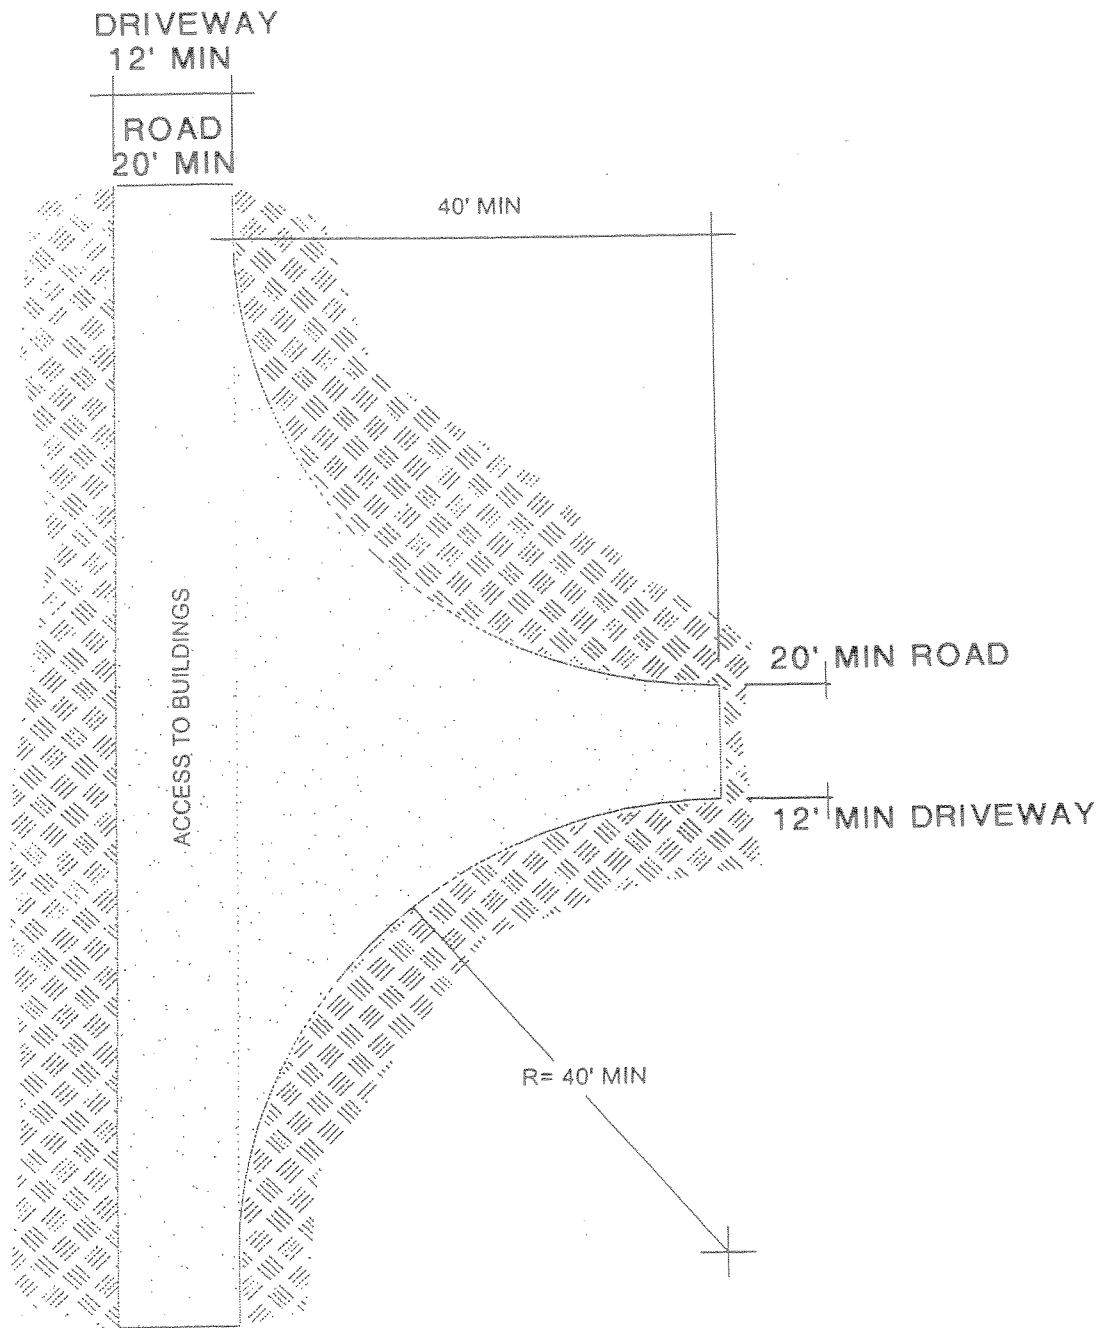


STUB-OUT TURNAROUND

Turnaround, Stub-Out, Road & Driveway

Uniform Fire Code & Fire Safe Standards


**AUBURN FIRE
DEPARTMENT**

9/2003

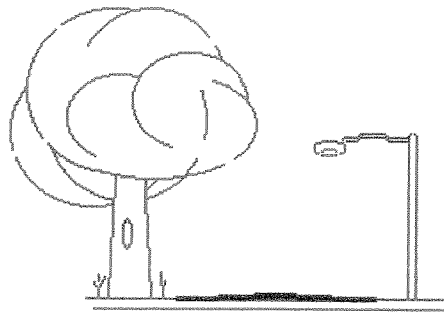

Vertical Clearance

Minimum 15'

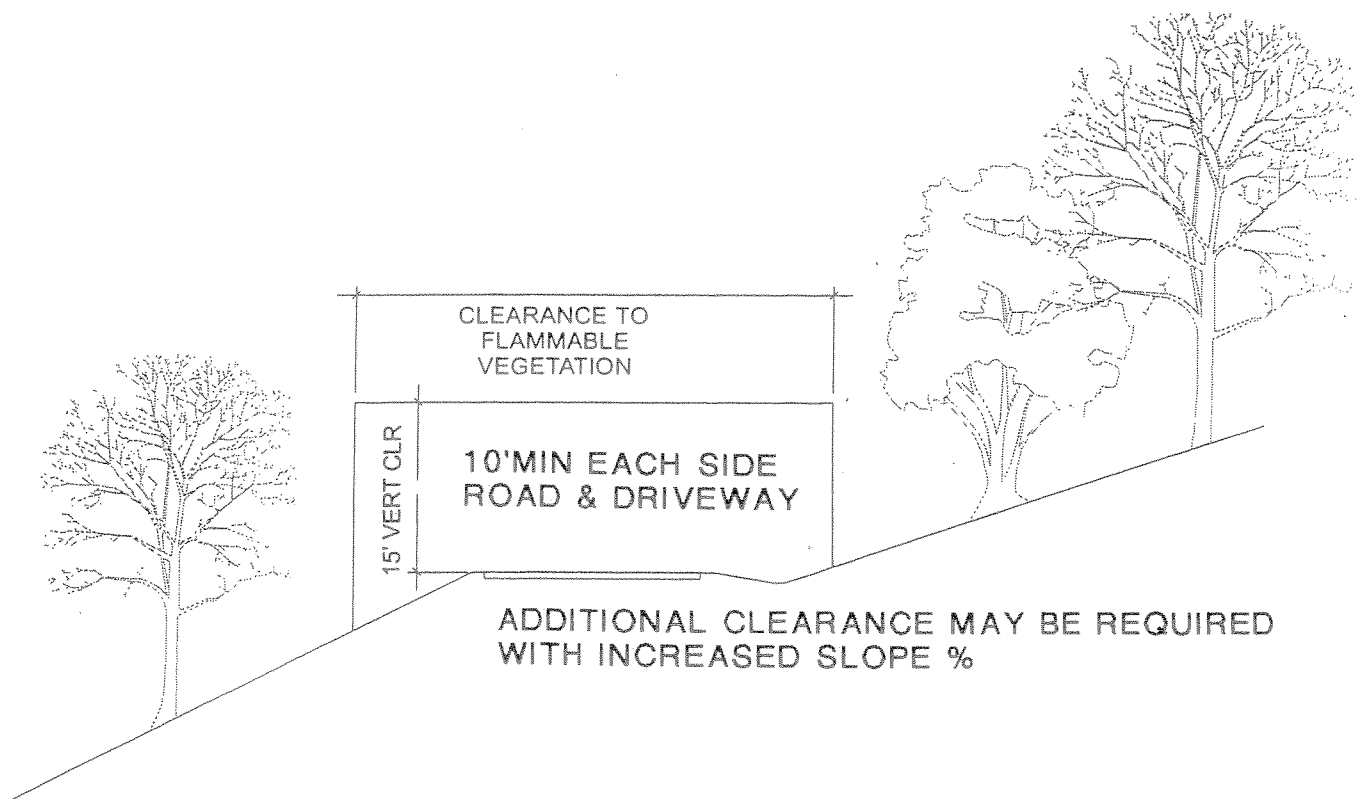

Road & Driveway, Clearance

Uniform Fire Code & Fire Safe Standards

**AUBURN FIRE
DEPARTMENT**

9/2003

TOTAL TO BE WIDTH
PLUS 1' SHOULDER EACH SIDE

FIRE DEPARTMENT APPROVED KEY ACCESS

GATE

12' DRIVEWAY
20' ROAD

1' MIN

SHOULDER

1' MIN

SHOULDER


GATE

Gate For Road, Private Lane, & Driveway

**AUBURN FIRE
DEPARTMENT**

Uniform Fire Code & Fire Safe Standards


9/2003

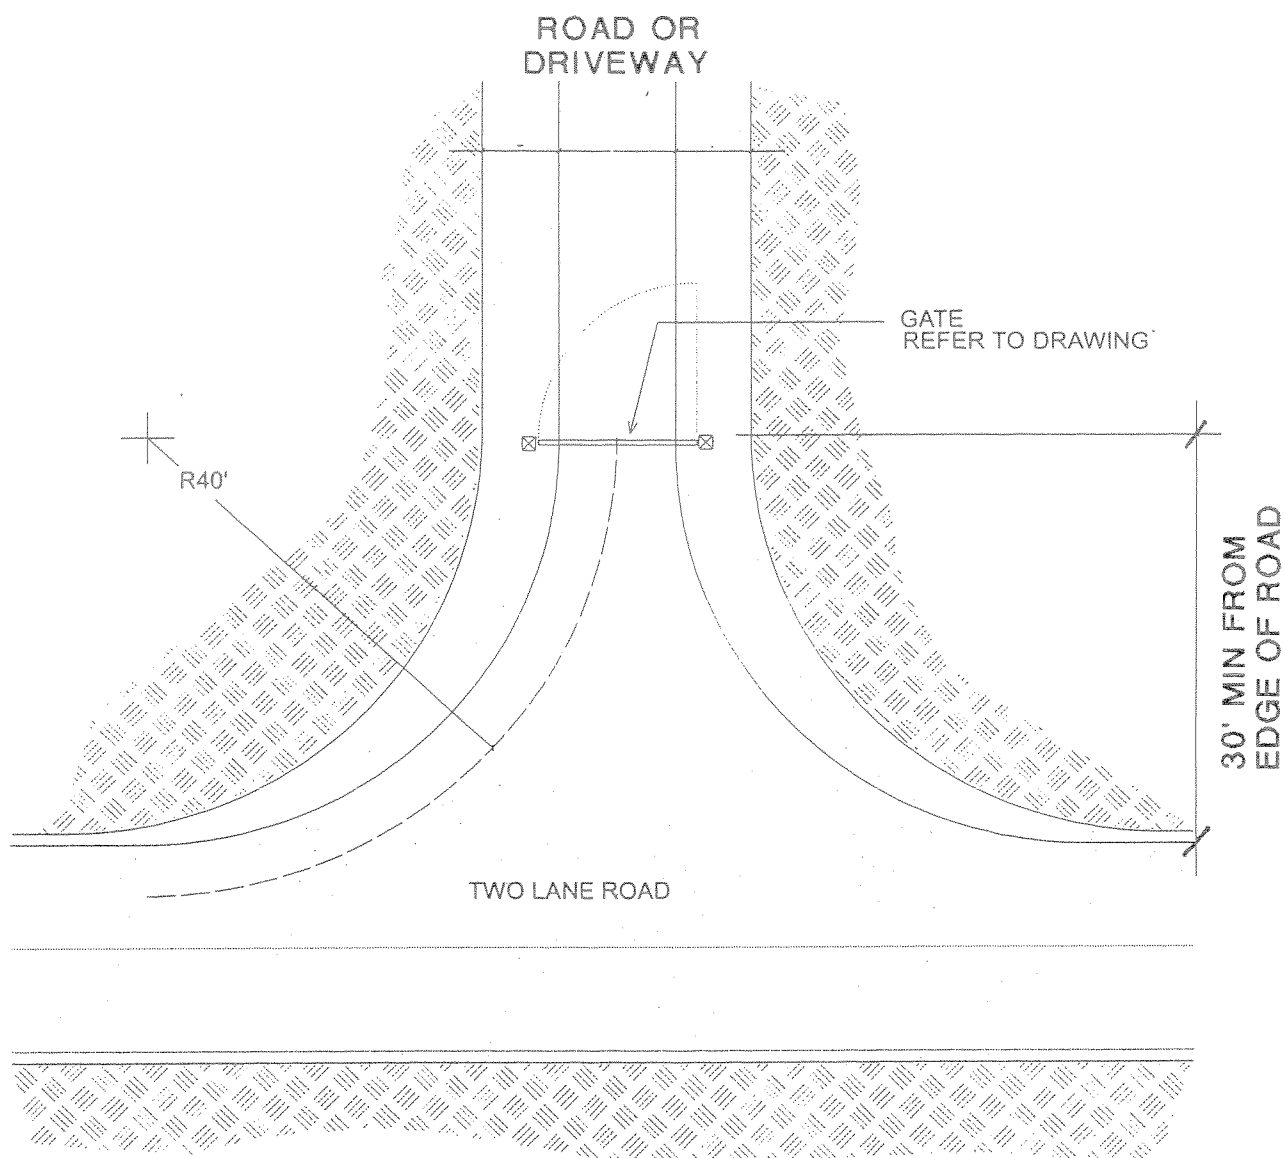

GATED ENTRANCES

- GATE ENTRANCE 2 FEET WIDER THAN WIDTH OF TRAFFIC LANE
- 30 FEET FROM THE ROADWAY, OPEN TO ALLOW A VEHICLE TO STOP WITHOUT OBSTRUCTING TRAFFIC
- CENTER LINE OF LANE TURNING RADIUS TO BE NOT LESS THAN 40'
- PROVIDE FIRE DEPARTMENT APPROVED KEY ACCESS

Gate Entrances

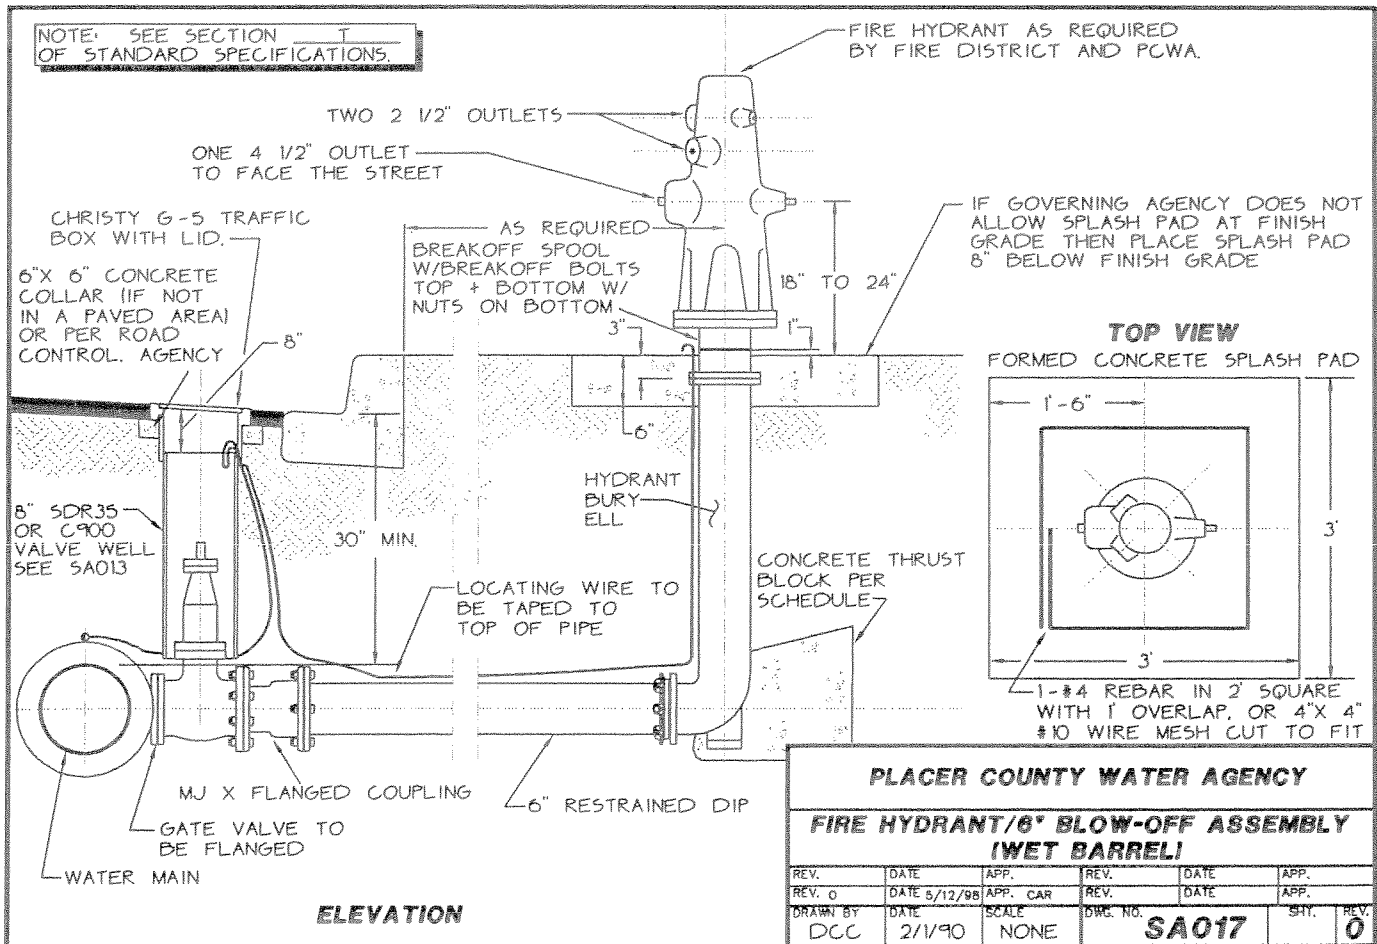


Fire Hydrant Assembly (Wet Barrel)

Placer County Water Agency

AUBURN FIRE
DEPARTMENT

9/2003

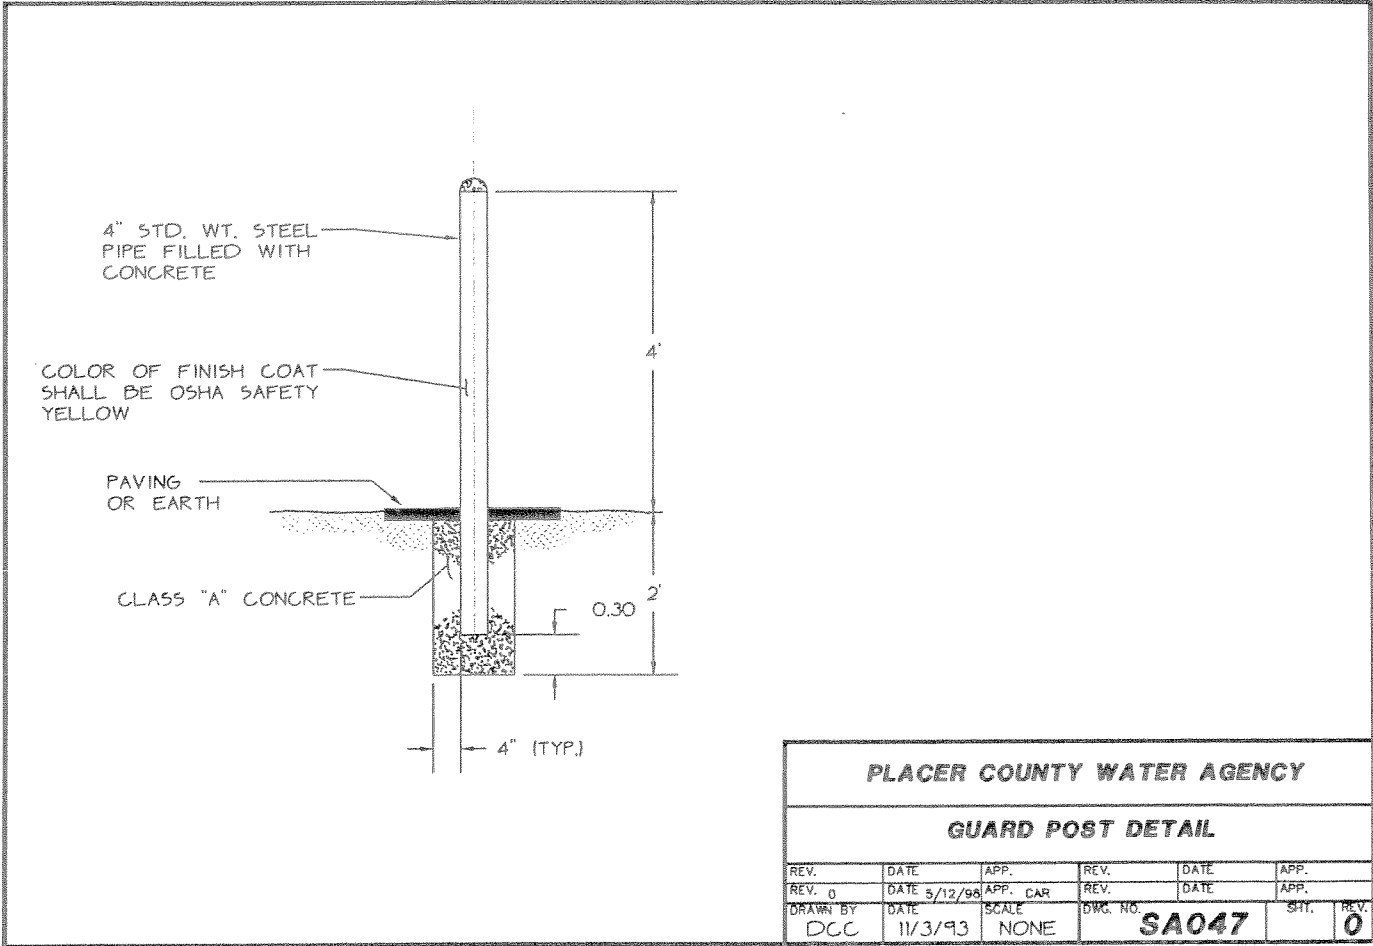


Guard Post-Ballard

Placer County Water Agency

**AUBURN FIRE
DEPARTMENT**

9/2003

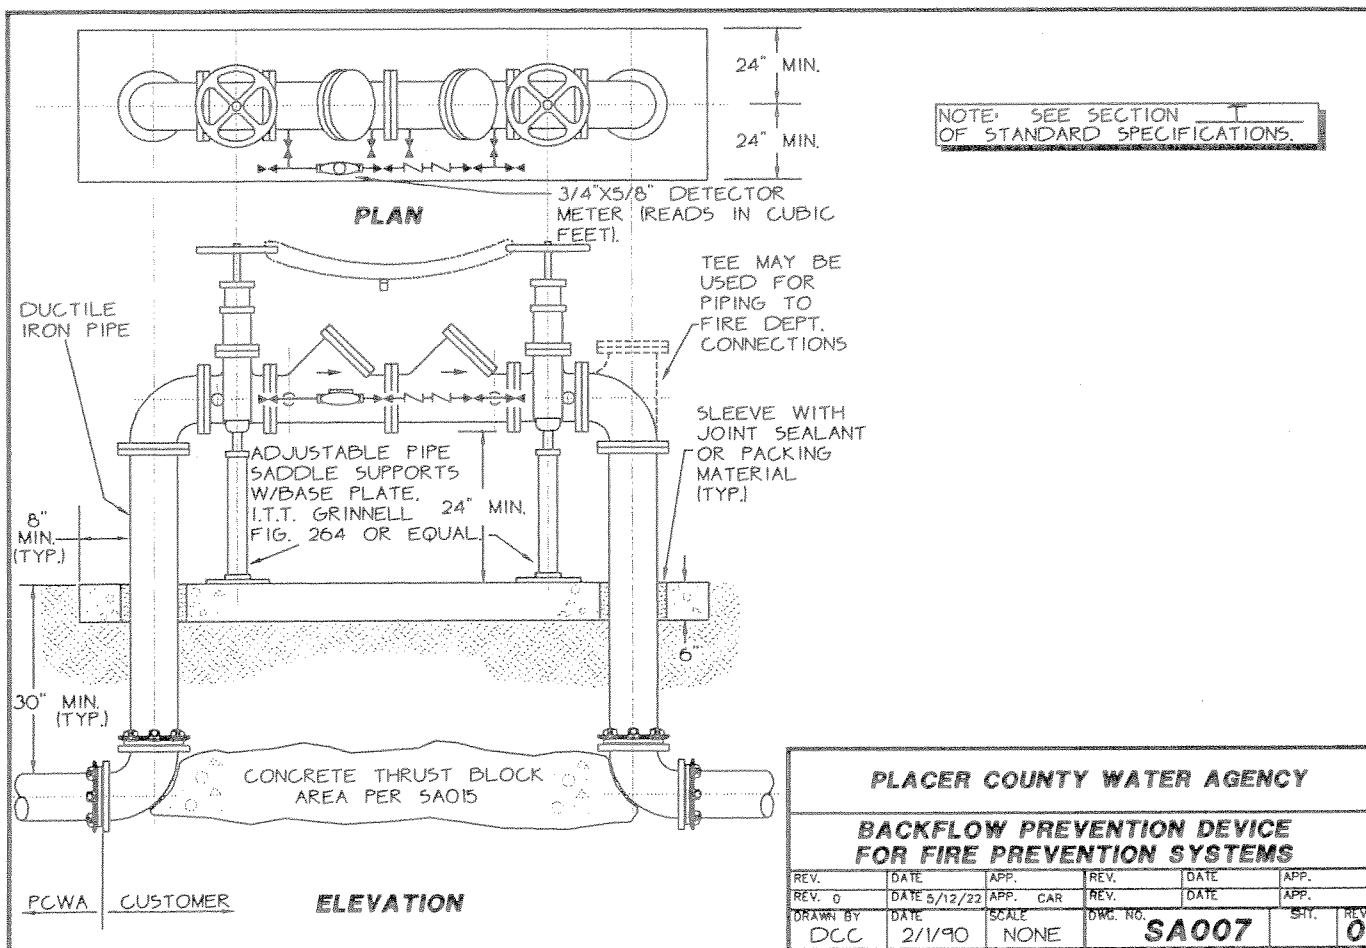


Backflow Prevention Device For Fire Protection Systems

Placer County Water Agency

AUBURN FIRE
DEPARTMENT

9/2003

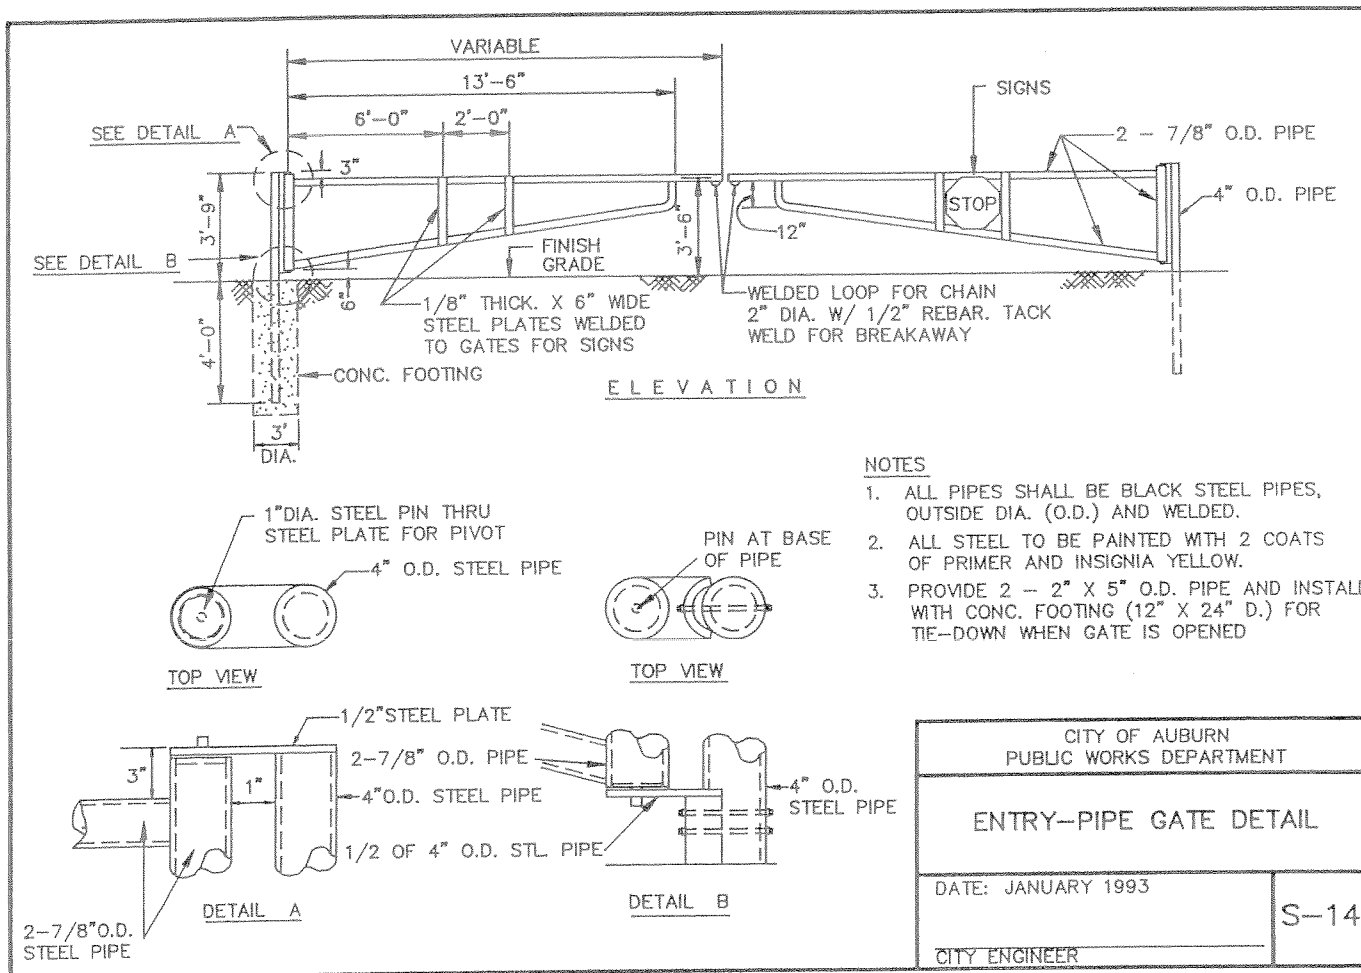


Entry-Pipe Gate, Two Lane

City of Auburn Public Works

**AUBURN FIRE
DEPARTMENT**

9/2003

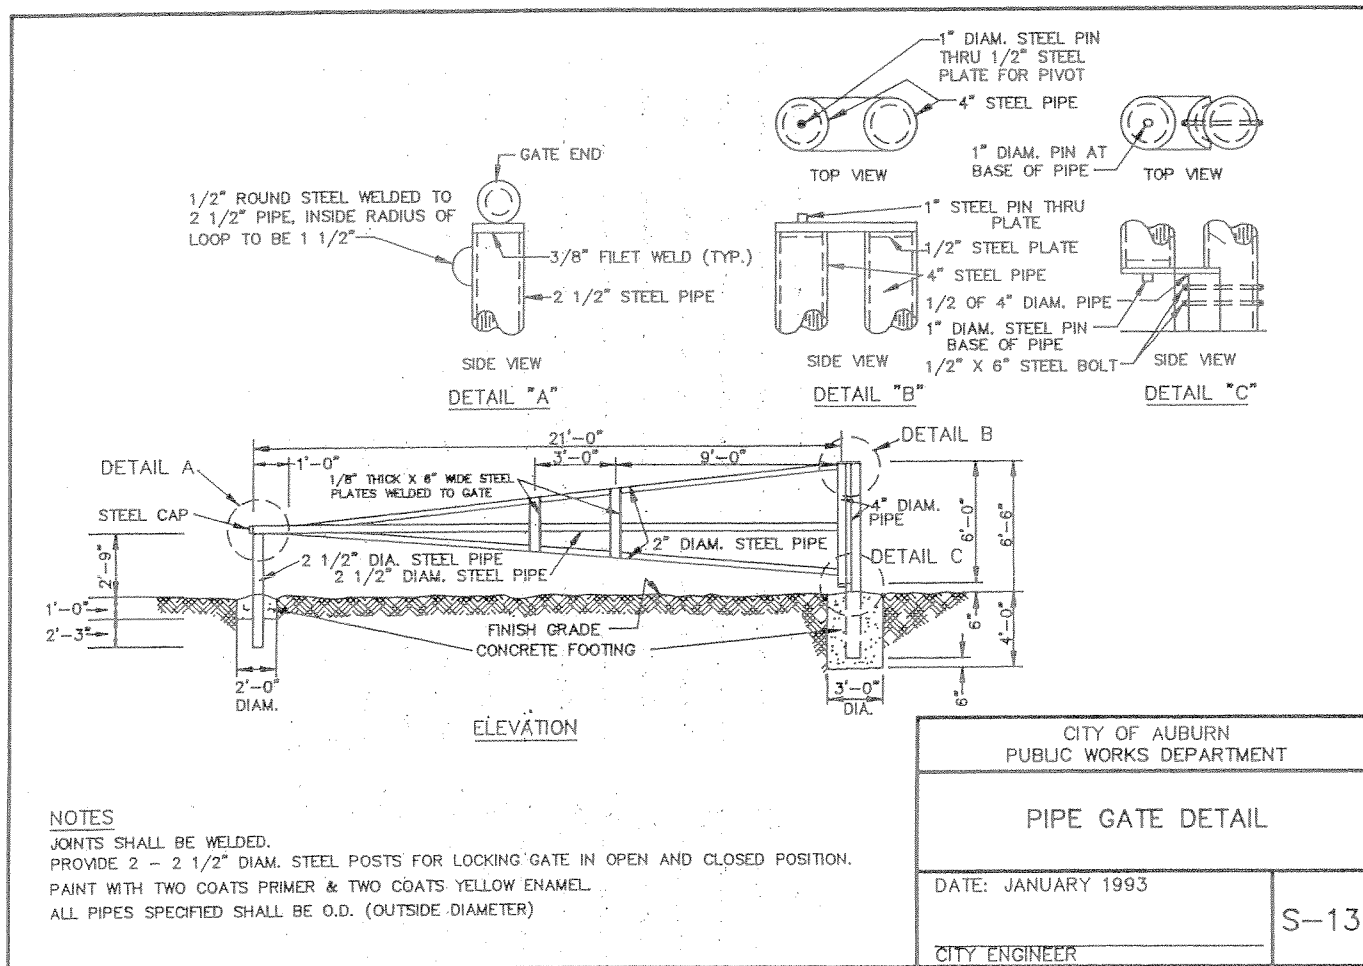

Entry-Pipe Gate, Single Lane/Access

City of Auburn Public Works

**AUBURN FIRE
DEPARTMENT**

9/2003